



COVID-19 Reinfection & Retesting Guidance

Owner: Clinical and Operations
Last Date Modified: October 10, 2022
Last Review: October 10, 2022

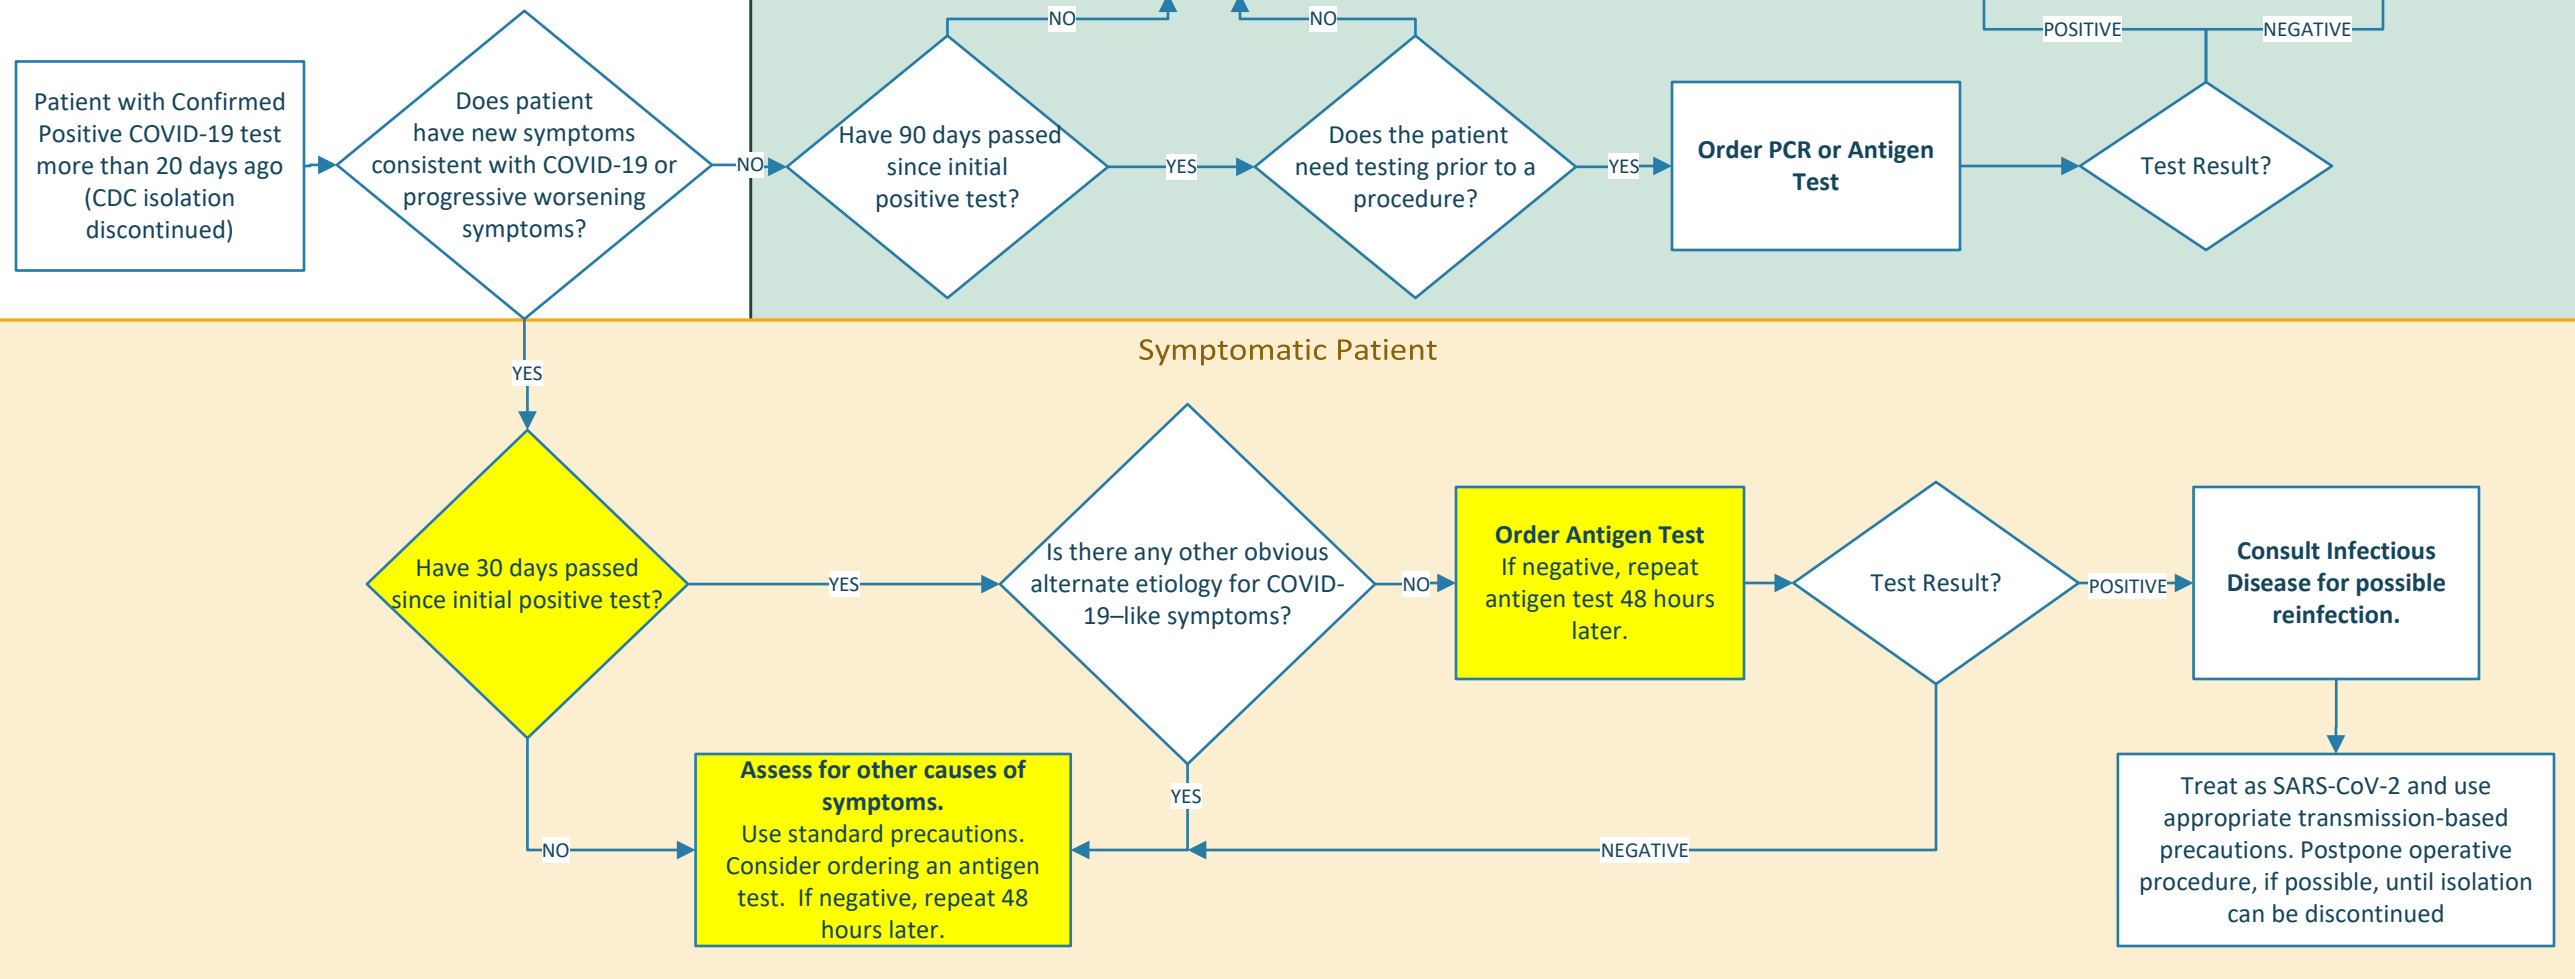

For CDC recommendations on retesting within 90 days of a positive test, see <https://www.cdc.gov/coronavirus/2019-ncov/symptoms-testing/testing.html>

Flu/COVID-19 Testing Algorithm

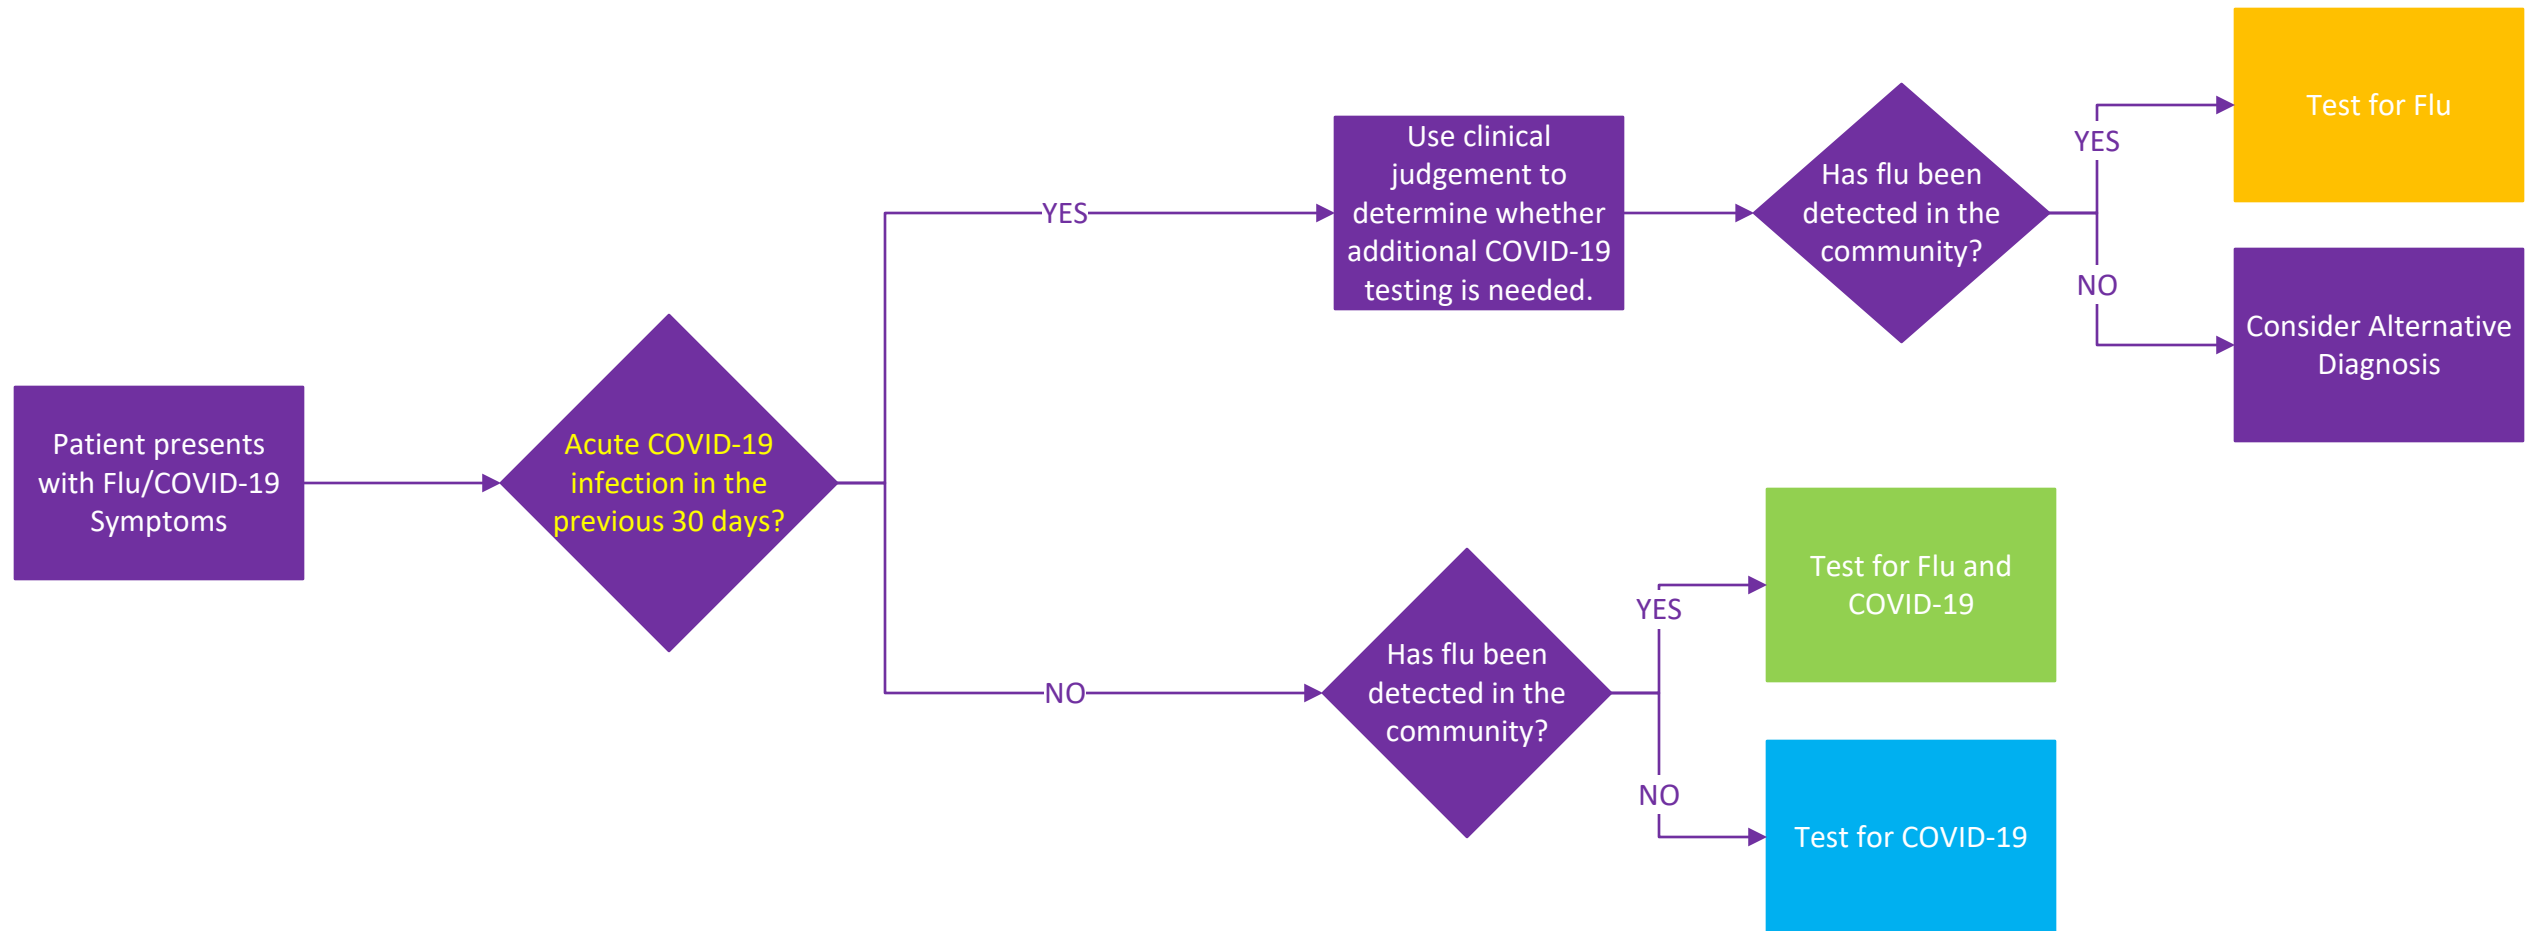

Note: Please follow your local/state requirements for testing if they are more stringent